

**OVERVIEW**

The Push-Button Wall Switch (sPODMA) Series of low voltage wall stations interface with standard Sensor Switch occupancy sensors and power packs in order to implement a wide range of single and bi-level switching applications. These switch devices provide an elegant and cost effective way of deploying bi-level lighting control that meet energy and building codes without having to source special sensors or power packs.

**FEATURES**

- Enables Standard Occupancy Sensors to be used for Manual On Operation
- Alternative Usage as Override Switch for Auto-On Applications
- Single Gang Decorator Style w/ either 1 or 2 On/Off Switches
- Soft-Click Push-Buttons
- Programmable w/o Removing Switch Plate
- Optional Dual Manual On Operation
- Optional Multi-way Operation
- Optional 0-10 VDC Dimming Control
- Auto return to last set level - on dimmable devices, returns to last set dim level before switched off

**Warranty**

Five-year limited warranty. This is the only warranty provided and no other statements in this specification sheet create any warranty of any kind. All other express and implied warranties are disclaimed. Complete warranty terms located at: [www.acuitybrands.com/support/warranty/terms-and-conditions](http://www.acuitybrands.com/support/warranty/terms-and-conditions)

**Note:** Actual performance may differ as a result of end-user environment and application. Specifications subject to change without notice



*sPODMA*  
*Wall Switch*



**sPODMA D**



Items marked by a shaded background qualify for the Design Select program and ship in 15 days or less. To learn more about Design Select, visit [www.acuitybrands.com/designselect](http://www.acuitybrands.com/designselect).  
\*See ordering tree for details



**ds** Design Select options indicated by this color background.

**ORDERING INFORMATION**


sPODMA		Example: sPODMA 347					
Series	Dimming	# of Switches/Default on Oper.	Multi-Way	Color	Temperature / Humidity		
sPODMA Wall Switch	[blank] None D <sup>1</sup> Dimming Operation	[blank] 1 Switch / Auto On SA 1 Switch / Manual On 2P 2 Switches (Pole 1 Manual / Pole 2 Auto) 2P 2SA 2 Switches (Both Poles Manual)	[blank] None 3X <sup>1</sup> Multi-Way (e.g. 3-way)	WH White IV Ivory GY Gray AL Lt. Almond BK Black RD Red	[blank] Standard LT Low Temp		

Notes  
1 Not available with 2 Pole (2P) option.

## TYPICAL CONFIGURATIONS


(NOTE: 18 AWG wire is recommended for all wiring)

### BI-LEVEL (MANUAL ON / AUTO ON) SOLUTION w/ OCCUPANCY SENSOR: 1 GANG

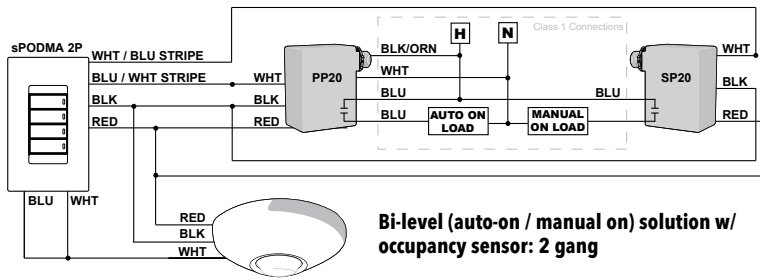


Bi-level (auto-on / manual on) solution w/ occupancy sensor: 2 gang


### MANUAL ON w/ DIMMING & OCCUPANCY SENSOR

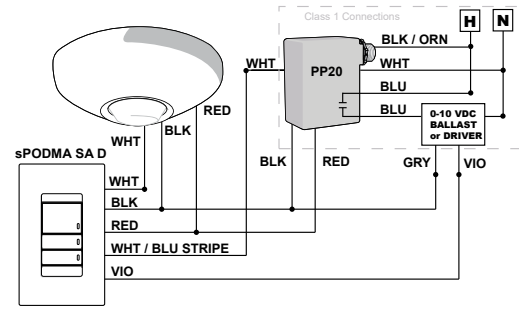

**Note:** If sensor also has dimming output (e.g., CM 9 ADC), connect sensor VIO wire to SPODMA and ballast/driver VIO wire. Lowest output level always takes precedence. If no sensor is used, connect the SPODMA white wire to the red wires.

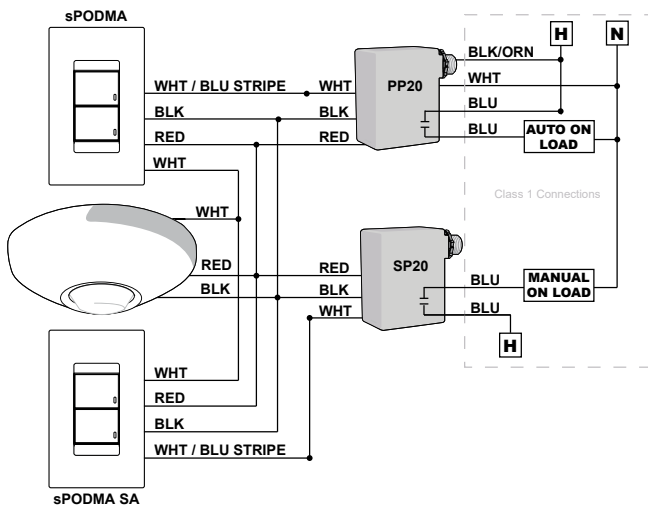

### 3-WAY MANUAL ON SOLUTION w/ OCCUPANCY SENSOR

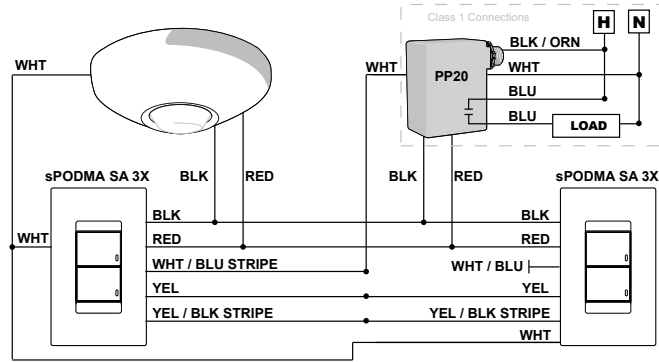

**Note 1:** SPODMA (SA) 3X D units should only be used in multi-way applications with SPODMA (SA) 3X units (non-dimming) as dimming levels are not communicated between devices.  
**Note 2:** For multi-way configurations greater than two units, connect additional unit(s) in same manner as bottom right SPODMA SA 3X unit in diagram above.  
**Note 3:** If no sensor is used, connect the SPODMA white wire to the red wires.

## PROGRAMMING INSTRUCTIONS *(Please read all 7 steps before programming)*

1. Enter programming mode by pressing & holding upper most button until LED flashes rapidly. Release button.
2. Enter the *On Mode* function by pressing button twice.
3. The current *On Mode* setting will then be fed out in a sequence of LED flashes as indicated in the table below (e.g., one flash for Auto-On). To change the setting, proceed to step 4 before sequence repeats 10 times.
4. At any time while the switch is flashing back the current *On Mode* setting, interrupt it by pressing button the number of times for the new desired *On Mode* setting as indicated in the table below (e.g., press twice for Manual On). Switch will begin to flash back new setting as confirmation.
5. Next, while the switch is flashing back new setting, interrupt it by pressing and holding button until LED flashes rapidly. Release button.
6. As final confirmation and activation of the new setting, press button two times.
7. LED will flash twice indicating acceptance of new setting. If two flashes are not seen, repeat 7 step process.

Note: To exit programming mode without saving, wait for blink back sequence to repeat 10 times then return to step 1.

Function Number	Function Name	Settings (see ordering block for defaults)		
		Setting Number	Pole 1	Pole 2 (2P devices only)
2	On Mode	1	Auto-On	Manual On
		2	Manual On	Auto-On
		3 (2P devices only)	Manual On	Manual On
		4 (2P devices only)	Auto-On	Auto-On

## SPECIFICATIONS

---

### Electrical

**Input Ratings** 12-24VAC/VDC, 5mA

**Output Ratings** Sinks <20mA  
- 800 W @ 120VAC  
- 1200 W @ 277VAC

---

### Mechanical

**Dimensions** 2.74"H x 1.68"W x 1.63"D (70mm x 43mm x 41mm) - does not include ground strap

**Mounting** Single-Gang Box or Low Voltage Ring

**Connection Type** Low Voltage Leads

---

### Environmental

**Warrantied Operating Temperature** 32°F to 176°F (0°C to 80°C)  
LT Option: -22°F to 176°F (-30°C to 80°C)

**Relative Humidity** Up to 90%, Non-Condensing

**Standards/ Ratings** RoHS

---

### General

**Standards/ Ratings** CEC Title 20